


COVINGTON ELECTRIC COOPERATIVE
OUTSIDE WALL INSTALLATION
METER SOCKET, SINGLE - PHASE

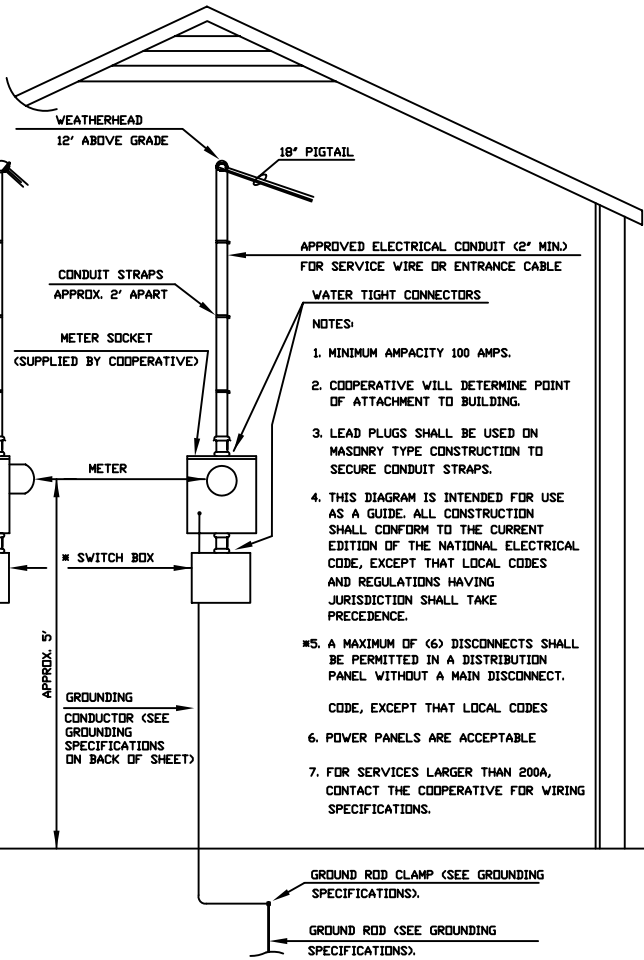

APPROVED ELECTRICAL CONDUIT (2" MIN.)
 FOR SERVICE WIRE OR ENTRANCE CABLE

WATER TIGHT CONNECTORS

NOTES:

1. MINIMUM AMPACITY 100 AMPS.
2. COOPERATIVE WILL DETERMINE POINT OF ATTACHMENT TO BUILDING.
3. LEAD PLUGS SHALL BE USED ON MASONRY TYPE CONSTRUCTION TO SECURE CONDUIT STRAPS.
4. THIS DIAGRAM IS INTENDED FOR USE AS A GUIDE. ALL CONSTRUCTION SHALL CONFORM TO THE CURRENT EDITION OF THE NATIONAL ELECTRICAL CODE, EXCEPT THAT LOCAL CODES AND REGULATIONS HAVING JURISDICTION SHALL TAKE PRECEDENCE.
5. A MAXIMUM OF (6) DISCONNECTS SHALL BE PERMITTED IN A DISTRIBUTION PANEL WITHOUT A MAIN DISCONNECT.
6. POWER PANELS ARE ACCEPTABLE
7. FOR SERVICES LARGER THAN 200A, CONTACT THE COOPERATIVE FOR WIRING SPECIFICATIONS.

GROUND ROD CLAMP (SEE GROUNDING SPECIFICATIONS).

GROUND ROD (SEE GROUNDING SPECIFICATIONS).